


Water Truck Filling Station Air Gap

Public Health Act, Nuisance and General Sanitation Regulation 243/2003, Section 12 states: “the equipment used for the transmission of the water is maintained in adequate operating condition and in a clean and sanitary condition”.

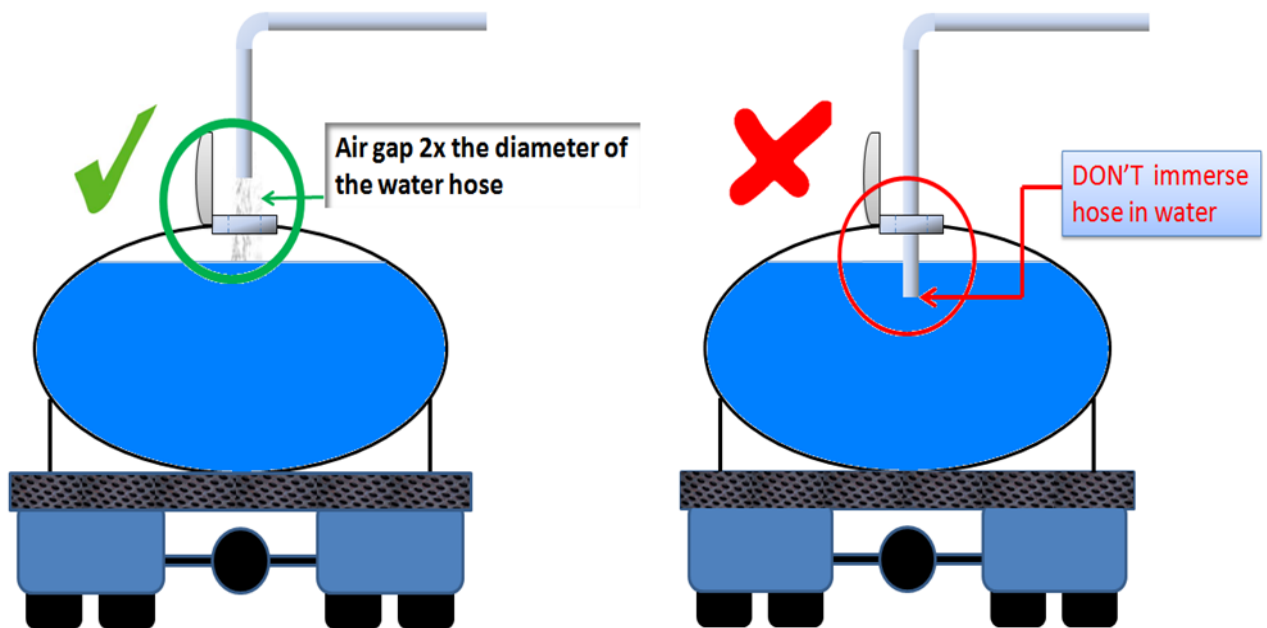

- **AN AIR GAP IS CONSIDERED THE MAXIMUM PROTECTION AVAILABLE AGAINST BACK SIPHONAGE AND CROSS CONTAMINATION.**
- **AN AIR GAP MUST EXIST WHILE YOU ARE FILLING.**
- **THE HOSE MUST NOT BE SUBMERSED IN YOUR WATER TANK.**
- **PROVIDE YOUR OWN HOSE.**

For more information, please contact your nearest Environmental Public Health office.

Edmonton Main Office
Calgary Main Office
Lethbridge Main Office

780-735-1800
403-943-2295
403-388-6689

Grande Prairie Main Office
Red Deer Main Office
www.albertahealthservices.ca/eph.asp

780-513-7517
403-356-6366

4EPHW-11-017
Created: Dec/11

